


NOTES:

1. FLAT TOPS MUST BE APPROVED BY THE ENGINEER.
2. GROUT ALL MANHOLE SECTION JOINTS AND PICKHOLES OUTSIDE AND INSIDE TO A SMOOTH FINISH.
3. GROUT FILL RING OR BRICK ADJUSTMENTS ON ALL SIDES. THE CASTING IS TO BE SEATED IN GROUT PLACED ON THE RING OR BRICK.
4. MORTAR A 3/8" LINING OUTSIDE AND INSIDE OF THE ADJUSTMENT SECTION TO FORM A SMOOTH WATERTIGHT FINISH.
5. ALL SANITARY SEWER MANHOLES SHALL BE VACUUM TESTED. IN AREAS OR LOCATIONS WHERE HIGH GROUND WATER TABLE EXIST, THE EXTERIOR OF THE MANHOLE SHALL BE COATED AND JOINT SEALANT TAPE USED TO PREVENT HYDROSTATIC WATER INFILTRATION.

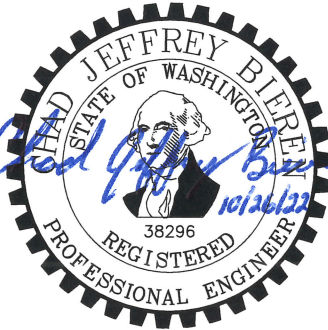

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT BUT AN ELECTRONIC DUPLICATE. THE ORIGINAL, SIGNED BY THE ENGINEER AND APPROVED FOR PUBLICATION IS KEPT ON FILE AT THE CITY OF KENT. A COPY MAY BE OBTAINED UPON REQUEST.

		CITY OF KENT ENGINEERING DEPARTMENT	
		SPECIAL SHALLOW MANHOLE	
DESIGNED	COK	SCALE	NONE
DRAWN	COK	DATE	04/2022
CHECKED	COK	ENGINEER	
APPROVED	<i>Chad Bierer</i>		
			4-2