


NOTES:

1. CAST IRON TO CONFORM TO A.S.T.M. A48-56 CLASS 30.
2. COVER SHALL BE OLYMPIC FOUNDRY M1007 OR EQUIVALENT MARKED "SEWER-CO" OR "CO".
3. TRACER WIRE = 12 GAUGE INSULATED SOLID COPPER WIRE, GREEN PLASTIC COATED. BARE END OF WIRE PERMANENTLY CONNECTED TO TEE AT MAIN WITH A SS HOSE CLAMP. WRAP SIDE SEWER AND INSTALL WIRE WITHIN CLEANOUT COVER, COIL ENOUGH LENGTH TO BRING ABOVE GRADE 18 INCHES FOR LOCATE PURPOSES.

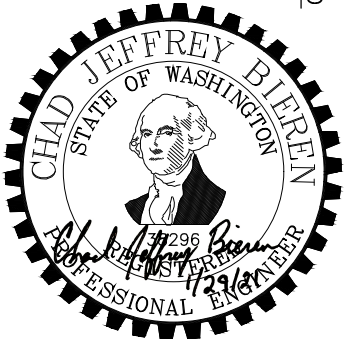

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT BUT AN ELECTRONIC DUPLICATE. THE ORIGINAL, SIGNED BY THE ENGINEER AND APPROVED FOR PUBLICATION IS KEPT ON FILE AT THE CITY OF KENT. A COPY MAY BE OBTAINED UPON REQUEST.

		CITY OF KENT ENGINEERING DEPARTMENT	
		6" CLEANOUT	
DESIGNED	COK	SCALE	NONE
DRAWN	COK	DATE	12/2019
CHECKED	COK	ENGINEER	
APPROVED		4-7	