


(2) 1/4"x3" GALVANIZED STEEL STRIPS

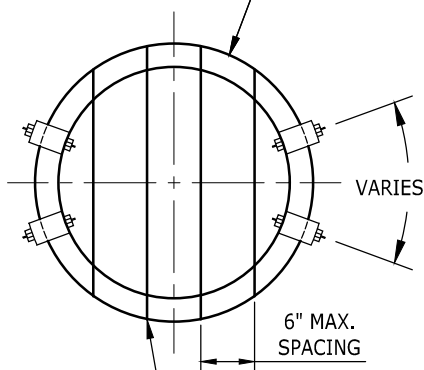


3/4" DIAMETER GALVANIZED STEEL BARS. WELD ENDS TO FRAME

3/4" DIAMETER GALVANIZED STEEL BAR

(4) 1/4"x2"x8" GALVANIZED STEEL STRIPS. BEND AND WELD TO FRAME, SPACE UNIFORMLY

VERIFY ANGLE OF BEVEL WITH RACK SUPPLIER. 1:1 OR GREATER REQUIRED

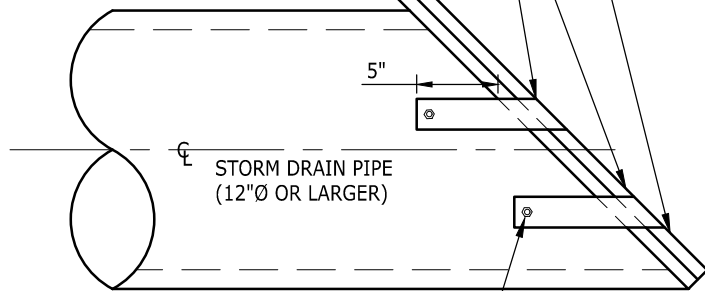


DRILL THROUGH PIPE MATERIAL & STEEL STRIPS. BOLT WITH 1/2" S. STEEL. HEX BOLTS

NOTES:

1. WELD AT ALL JOINTS.
2. SHOP DRAWINGS REQUIRED.
3. ALL STEEL IN PLATES, BARS AND BANDS SHALL CONFORM TO THE REQUIREMENTS OF ASTM A36.
4. DEBRIS CAGE SHALL BE HOT-DIP GALVANIZED IN ACCORDANCE WITH AASHTO M111 (ASTM A123).
5. GALVANIZING SHALL BE PER WSDOT STD. SPECIFICATION 9-05.16.

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT BUT AN ELECTRONIC DUPLICATE. THE ORIGINAL, SIGNED BY THE ENGINEER AND APPROVED FOR PUBLICATION IS KEPT ON FILE AT THE CITY OF KENT. A COPY MAY BE OBTAINED UPON REQUEST.



		CITY OF KENT ENGINEERING DEPARTMENT	
		TRASH SCREEN	
DESIGNED <u>COK</u>	SCALE <u>NONE</u>	STANDARD PLAN	
DRAWN <u>COK</u>	DATE <u>12/2019</u>	5-20	
CHECKED <u>COK</u>	ENGINEER		
APPROVED _____			