


JOINTS IN FILTER FABRIC SHALL BE SPLICED AT POSTS. USE STAPLES, WIRE RINGS, OR EQUIVALENT TO ATTACH FABRIC TO POSTS.

FILTER FABRIC MATERIAL MIRAFI 100X OR QUIVALENT

SECTION A-A

2"x2"x14 GAUGE WELDED WIRE FABRIC OR EQUAL (IF 180# EXTRA STRENGTH FABRIC IF USED MAY ELIMINATE WIRE FABRIC)

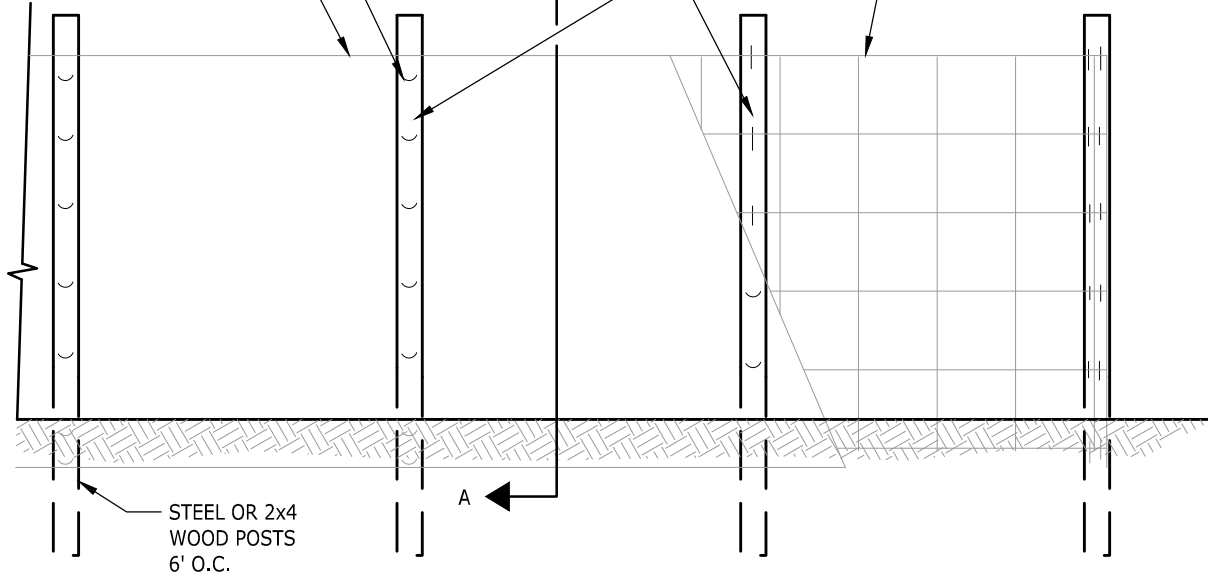


ELEVATION

INSTALLATION NOTES:

1. FILTER FABRIC FENCE SHALL BE REMOVED WHEN THEY HAVE SERVED THEIR USEFUL PURPOSE AFTER THE UPSLOPE AREA HAS BEEN PERMANENTLY STABILIZED. THE NEWLY DISTURBED AREAS RESULTING FROM FILTER FABRIC REMOVAL SHALL BE IMMEDIATELY SEEDED AND MULCHED OR STABILIZED AS APPROVED BY THE ENGINEER.
2. FILTER FABRIC FENCES SHALL BE INSPECTED IMMEDIATELY AFTER EACH RAINFALL AND AT LEAST DAILY DURING PROLONGED RAINFALL. ANY REQUIRED REPAIRS SHALL BE MADE IMMEDIATELY.
3. REMOVE SEDIMENT WHEN IT REACHES 1/3 FENCE HEIGHT.
4. INSTALL THE SILT FENCE FIRST. AFTER THE SILT FENCE HAS BEEN INSTALLED, CONSTRUCT BERM AND TRENCH.



NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT BUT AN ELECTRONIC DUPLICATE. THE ORIGINAL, SIGNED BY THE ENGINEER AND APPROVED FOR PUBLICATION IS KEPT ON FILE AT THE CITY OF KENT. A COPY MAY BE OBTAINED UPON REQUEST.

		CITY OF KENT ENGINEERING DEPARTMENT	
		FILTER FABRIC FENCE	
DESIGNED <u>COK</u>	SCALE <u>NONE</u>	STANDARD PLAN	
DRAWN <u>COK</u>	DATE <u>12/2019</u>	5-31	
CHECKED <u>COK</u>	ENGINEER		
APPROVED			